

IS : 4571 - 1977
(Reaffirmed 2000)
Edition 2.5
(1989-02)

Indian Standard

**SPECIFICATION FOR
ALUMINIUM EXTENSION LADDERS
FOR FIRE BRIGADE USE**

(First Revision)

(Incorporating Amendment Nos. 1, 2, 3, 4 & 5)

UDC 614.847.12 : 669.71

© BIS 2004

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Price Group 2

Indian Standard
SPECIFICATION FOR
ALUMINIUM EXTENSION LADDERS
FOR FIRE BRIGADE USE
(First Revision)

Fire Fighting Sectional Committee, BDC 22

<i>Chairman</i>	<i>Representing</i>
SHRI P. N. MEHROTRA	Ministry of Home Affairs
<i>Members</i>	
SHRI MAHESH C. AGRAWAL	Brijbasi Udyog, Mathura (UP)
SHRI P. S. BANERJEE (<i>Alternate</i>)	
ASSISTANT SECURITY OFFICER (FIRE), NORTHERN RAILWAY	Railway Board (Ministry of Railways)
DR G. N. BADAMI	Central Building Research Institute (CSIR), Roorkee
SHRI GOPAL KRISHAN (<i>Alternate</i>)	
SHRI S. R. BANSAL	Bokaro Steel Limited, Bokaro Steel City
SHRI P. K. BHARUCHA	Tariff Advisory Committee, Bombay
SHRI A. CHATTERJI (<i>Alternate</i>)	
SHRI S. C. CHATTERJEE	West Bengal Fire Services, Calcutta
SHRI D. K. BANERJEE (<i>Alternate</i>)	
SHRI K. DADABHOY	Hindustan Steel Limited, Ranchi
SHRI C. D. SHARMA (<i>Alternate</i>)	
SHRI R. R. DHOBLEY	Bhabha Atomic Research Centre, Trombay, Bombay
DIRECTOR, FIRE SERVICE	Home (Police) Department, Government of Andhra Pradesh, Hyderabad
SHRI P. N. GHOSH	Ministry of Defence (R & D)
SHRI A. N. AHLUWALIA (<i>Alternate</i>)	
SHRI G. N. GIDWANI	Directorate General of Supplies & Disposals, New Delhi
SHRI H. C. VERMA (<i>Alternate</i>)	
SHRI D. P. GUPTA	Directorate General of Technical Development, New Delhi
DR D. S. JAISWAR	Avon Services (P & A) Pvt Ltd, Bombay
SHRI H. M. SABADRA (<i>Alternate</i>)	
SHRI J. S. JAMSHEDJI	Steelage Industries Limited (Minimax Division), Calcutta
SHRI H. K. ERANI (<i>Alternate</i>)	

(Continued on page 2)

© BIS 2004

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

IS : 4571 - 1977

(Continued from page 1)

<i>Members</i>	<i>Representing</i>
SHRI S. N. KUNDU	Fire & Safety Appliances Co, Calcutta
SHRI S. PAUL (<i>Alternate</i>)	
SHRI B. R. MEHTA	Central Industrial Security Force (Ministry of Home Affairs), New Delhi
SHRI R. MEHTA	Air Foam Industries Private Ltd, New Delhi
MAJ S. K. MISRA	Ministry of Defence (DGI)
SHRI D. K. MAJUMDER	Allen Richards & Co, Calcutta
SHRI A. K. SARKAR (<i>Alternate</i>)	
SHRI H. C. RAI CHOUDHURY	Directorate General of Civil Aviation, New Delhi
SHRI I. RATHINASAMI	Home Department (Fire Service), Government of Tamil Nadu, Madras
SHRI G. S. SALVI	Municipal Corporation of Greater Bombay (Bombay Fire Brigade), Bombay
SHRI P. L. SEBASTIN	Oil & Natural Gas Commission, Dehra Dun
SHRI V. V. KIMMATKAR (<i>Alternate</i>)	
SHRI P. H. SETHNA	Kooverji Devshi & Co Pvt Ltd, Bombay
SHRI N. T. PANJWANI (<i>Alternate</i>)	
SHRI J. V. SHAH	Newage Industries, Surendranagar
SHRI B. J. SHAH (<i>Alternate</i>)	
SHRI VARUN SHARMA	DGL Private Limited, New Delhi
SHRI T. R. BHANOT (<i>Alternate</i>)	
SHRI D. K. SIRKAR	Synthetics & Chemicals Limited, Bareilly
SHRI R. S. SUNDARAM	Municipal Corporation of Delhi (Delhi Fire Service), Delhi
SHRI TARIT SUR	Sur Enamel & Stamping Works Private Limited, Calcutta
SHRI S. SUR (<i>Alternate</i>)	
SHRI N. P. VERGHESE	Heavy Engineering Corporation Ltd, Ranchi
SHRI B. V. WAGLE	Urban Development, Public Health and Housing Department, Government of Maharashtra, Bombay
SHRI V. H. MADKAIKAR (<i>Alternate</i>)	
SHRI D. AJITHA SIMHA, Director (Civ Engg)	Director General, ISI (<i>Ex-officio Member</i>)

Secretary

SHRI K. M. MATHUR
Deputy Director (Civ Engg), ISI

Fire Fighting Units Subcommittee, BDC 22 : 3

Convener

SHRI P. N. GHOSH Ministry of Defence (R & D)

Members

LT-COL M. N. MENON (*Alternate to*
Shri P. N. Ghosh)
SHRI G. Y. BHATT Premier Automobiles Ltd, Bombay
SHRI M. L. MAHAJAN (*Alternate*)

(Continued on page 8)

Indian Standard
 SPECIFICATION FOR
 ALUMINIUM EXTENSION LADDERS
 FOR FIRE BRIGADE USE
 (*First Revision*)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 30 November 1977, after the draft finalized by the Fire Fighting Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Wooden extension ladders for fire fighting purposes have already been covered in IS : 930-1977*. During the course of working to this standard, it has been felt that timber ladders being difficult to handle because of their heavy mass, often present difficulties to the fire fighting personnel at the time of fire fighting. Aluminium ladders being lighter are now being preferred to timber ladders by the fire fighting personnel. This standard was published in 1968. Based on the indigenous availability of aluminium section this revision has been prepared, the principal modification being relaxation in regard to the deflection.

0.2.1 The aluminium extension ladder consist of one main and one extending section. The design shall be such as to ensure easy sliding of the extending section without excessive clearance in the guide and over extension of the ladder. The extending section shall be guided throughout the full range of extension in a manner such that the sections cannot separate, retaining clips being on the main section. If so required, an operating gear is fixed to facilitate removal of the extending section for separate use.

0.3 This edition 2.5 incorporates Amendment No. 1 (March 1979), Amendment No. 2 (September 1981), Amendment No. 3 (January 1984), Amendment No. 4 (October 1984) and Amendment No. 5 (February 1989). Side bar indicates modification of the text as the result of incorporation of the amendments.

0.4 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960†. The number of significant places

*Specification for wooden extension ladder for fire fighting purposes (*first revision*).

†Rules for rounding off numerical values (*revised*).

IS : 4571 - 1977

retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard lays down the requirements regarding material, size, mass and performance tests of aluminium extension ladders for fire fighting purposes.

2. GENERAL

2.1 Ladder — The width of the extending section inside its strings shall be not less than 30 cm. The rounds shall be with non-slip serrations running the full length. These shall be fixed by expanding and flaring and shall be spaced at 25 cm centre to centre.

2.2 Safety Device — The heels of the stiles or strings of lower section shall be fitted with rubber feet. The pawls shall be bolted to stiles or strings and their action shall be such that they are set for engagement until they have been rested on a round, and trip to clear immediately the ladder is extended.

3. MATERIAL

3.1 The aluminium alloy section for stiles or strings shall conform to aluminium alloy 64430 WP or 65032 WP of IS : 733-1983* and IS : 1285-1975†.

3.2 The aluminium alloy section used for the rounds of the ladder shall conform to aluminium alloy 64430 WP or 65032 WP of IS : 733-1983* and IS : 1285-1975†.

3.3 Aluminium alloy latch shall be produced from aluminium alloy conforming to IS Designation 4600 of IS : 617-1975‡ by chill casting.

3.4 Rubber feet of aluminium ladder shall have shear hardness of 50 to 60.


4. SIZE

4.1 Extension ladders when fully extended shall meet the required sizes of 4.5, 7.5 and 10.5 m and overlap as shown in Fig. 1; when closed the distance between the same extremities of top and bottom sliding ladder shall not exceed 750 mm.

*Specification for wrought aluminium and aluminium alloy, bars rods and sections (for general engineering purposes) (*third revision*).

†Specification for wrought aluminium and aluminium alloys, extruded round tube and hollow sections (for general engineering purposes) (*second revision*).

‡Specification for aluminium and aluminium alloy ingots and castings for general engineering purposes (*second revision*).

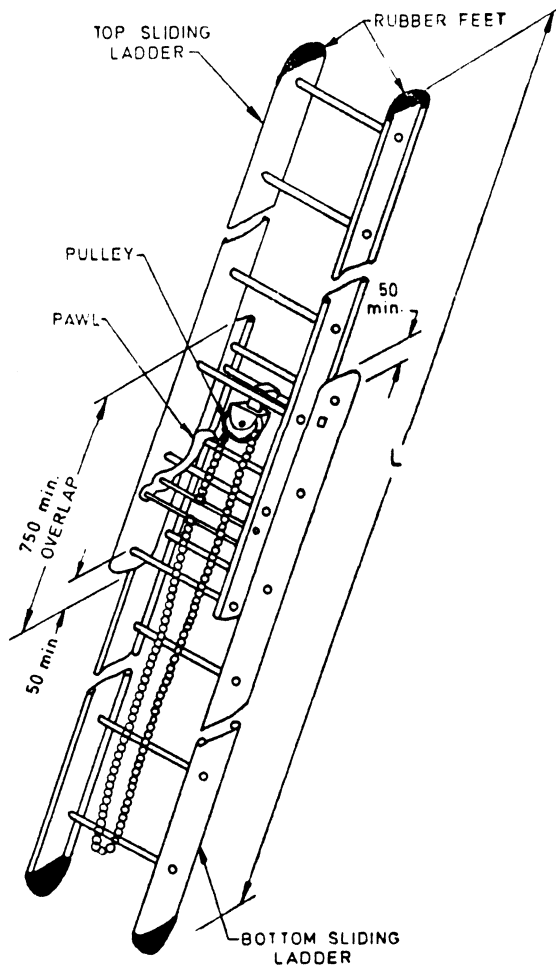

L Means Extended Length of Ladder

All dimensions in millimetres.

FIG. 1 TYPICAL SKETCH OF EXTENSION LADDER

5. MASS

5.1 The ladders shall be as light as possible, their total mass shall not exceed as given below:

4.5 m	20 kg
7.5 m	30 kg
10.5 m	48 kg

6. TEST REQUIREMENTS

6.1 Deflection — The fully extended ladder shall be placed across trestles, positioned 90 cm from each end. On a 30 cm wide board placed across the strings at the centre of the span, a load of 373 N (38 kgf) shall be applied, allowed to remain there for a period of not less than 1 minute and then removed. A load of 736 N (75 kgf) shall then be gradually applied and the deflection due to this load shall not exceed 30 cm measured from the original position. The load shall then be gradually increased to 1098 N (112 kgf) and the additional deflection shall not exceed 50 percent of the deflection obtained with the 736 N (75 kgf). There shall be no sign of distress.

6.2 Strength of Round

6.2.1 With the feet of the ladder at a distance of 2.5 m in the case of 10.5 m, 1.75 m in the case of 7.5 m, and 1.25 m in the case of 4.5 m ladder from wall, the ladder shall be fully extended and its head rested against the wall. A load of 320 kgf shall then be gradually applied to the middle of at least one round in each section by means of a metal hook having a bearing surface 5 cm wide and suitably lined to prevent bruising of the round. No sign of failure shall be apparent either in the round or at its junction with the strings.

6.2.2 The fully extended ladder shall be placed vertically and a man weighing approximately 75 kg shall jump on each round from the round immediately above. No sign of failure shall be apparent either in the round or at its junction with the strings during this test.

6.2.3 The fully extended ladder shall be placed horizontally across trestles. One man weighing approximately 75 kg shall walk over the rounds. No sign of failure shall be apparent either in the round or at its junction with the strings during this test.

6.3 Sway — When pitched against a wall with feet of the ladder 1.25 m, 1.75 m and 2.5 m away from the wall in the case of 4.5 m, 7.5 m and 10.5 m ladders respectively and two men are ascending the ladder or one man carrying another while descending the ladders, it shall not sway.

6.4 Extension — The ladder shall be capable of being extended by one man by means of rope of breaking strength not less than 1 000 kgf. The ladder shall also be not over extended.

7. MARKING

7.1 Each extension ladder shall be clearly and permanently marked with the following information:

- a) Manufacturer's name or trade-mark, if any;
- b) The size of the ladder; and
- c) Year of manufacture.

7.1.1 The extension ladder may also be marked with the ISI Certification Mark.

NOTE — The use of the ISI Certification Mark is governed by the provisions of the Indian Standards Institution (Certification Marks) Act and the Rules and Regulations made thereunder. The ISI Mark on products covered by an Indian Standard conveys the assurance that they have been produced to comply with the requirements of that standard under a well-defined system of inspection, testing and quality control which is devised and supervised by ISI and operated by the producer. ISI marked products are also continuously checked by ISI for conformity to that standard as a further safeguard. Details of conditions under which a licence for the use of the ISI Certification Mark may be granted to manufacturers or processors, may be obtained from the Indian Standards Institution.

8. SAMPLING AND CRITERIA FOR CONFORMITY

8.1 Each ladder shall be checked for the various requirements specified in this standard.

IS : 4571 - 1977

(Continued from page 2)

<i>Members</i>	<i>Representing</i>
SHRI S. C. CHATTERJEE	West Bengal Fire Services, Calcutta
SHRI G. N. GIDWANI	Directorate General of Supplies & Disposals, New Delhi
SHRI H. C. VERMA (<i>Alternate</i>)	
WG CDR J. M. KAUSHAL	Directorate of Maintenance, Plans & Inspection (Ministry of Defence), New Delhi
SHRI R. B. MOHINDRA (<i>Alternate</i>)	
SHRI P. N. MEHROTRA	Ministry of Home Affairs
SHRI A. G. NARSAPUR	Kirloskar Brothers Limited, New Delhi
SHRI S. V. PARADKAR (<i>Alternate</i>)	
SHRI H. C. RAI CHOUDHURY	Directorate General of Civil Aviation, New Delhi
SHRI G. S. SALVI	Municipal Corporation of Greater Bombay (Bombay Fire Brigade), Bombay
DR A. K. SEN	Ministry of Defence (DGI)
SHRI P. H. SETHNA	Kooverji Devshi & Co Pvt Ltd, Bombay
SHRI N. T. PANJWANI (<i>Alternate</i>)	
SHRI D. K. SIRKAR	Synthetics & Chemicals Ltd, Bareilly
SHRI R. S. SUNDARAM	Municipal Corporation of Delhi (Delhi Fire Service), Delhi
SHRI B. V. WAGLE	Urban Development Public Health, Housing Department (Government of Maharashtra), Bombay
SHRI V. H. MADKAIKAR (<i>Alternate</i>)	

INTERNATIONAL SYSTEM OF UNITS (SI UNITS)**Base Units**

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>
Length	metre	m
Mass	kilogram	kg
Time	second	s
Electric current	ampere	A
Thermodynamic temperature	kelvin	K
Luminous intensity	candela	cd
Amount of substance	mole	mol

Supplementary Units

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>
Plane angle	radian	rad
Solid angle	steradian	sr

Derived Units

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>	<i>Conversion</i>
Force	newton	N	1 N = 0.101 972 kgf
Energy	joule	J	1 J = 1 N.m
Power	watt	W	1 W = 1 J/s
Flux	weber	Wb	1 Wb = 1 V.s
Flux density	tesla	T	1 T = 1 Wb/m ²
Frequency	hertz	Hz	1 Hz = 1 c/s (s ⁻¹)
Electric conductance	siemens	S	1 S = 1 A/V
Pressure, stress	pascal	Pa	1 Pa = 1 N/m ²

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 1986* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards : Monthly Additions'.

This Indian Standard has been developed by Technical Committee : BDC 22

Amendments Issued Since Publication

Amend No.	Date of Issue
Amd. No. 1	March 1979
Amd. No. 2	September 1981
Amd. No. 3	January 1984
Amd. No. 4	October 1984
Amd. No. 5	February 1989

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002.
Telephones: 323 01 31, 323 33 75, 323 94 02

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:

	Telephone
Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	{ 323 76 17 323 38 41
Eastern : 1/14 C. I. T. Scheme VII M, V. I. P. Road, Kankurgachi KOLKATA 700054	{ 337 84 99, 337 85 61 337 86 26, 337 91 20
Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022	{ 60 38 43 60 20 25
Southern : C. I. T. Campus, IV Cross Road, CHENNAI 600113	{ 235 02 16, 235 04 42 235 15 19, 235 23 15
Western : Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	{ 832 92 95, 832 78 58 832 78 91, 832 78 92
Branches : AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. NALAGARH. PATNA. PUNE. RAJKOT. THIRUVANANTHAPURAM. VISHAKHAPATNAM	